


2019



Fingerprint at US-PFr_manual_itc_filt:
 Reco_DT ($\mu\text{mol m}^{-2} \text{s}^{-1}$)

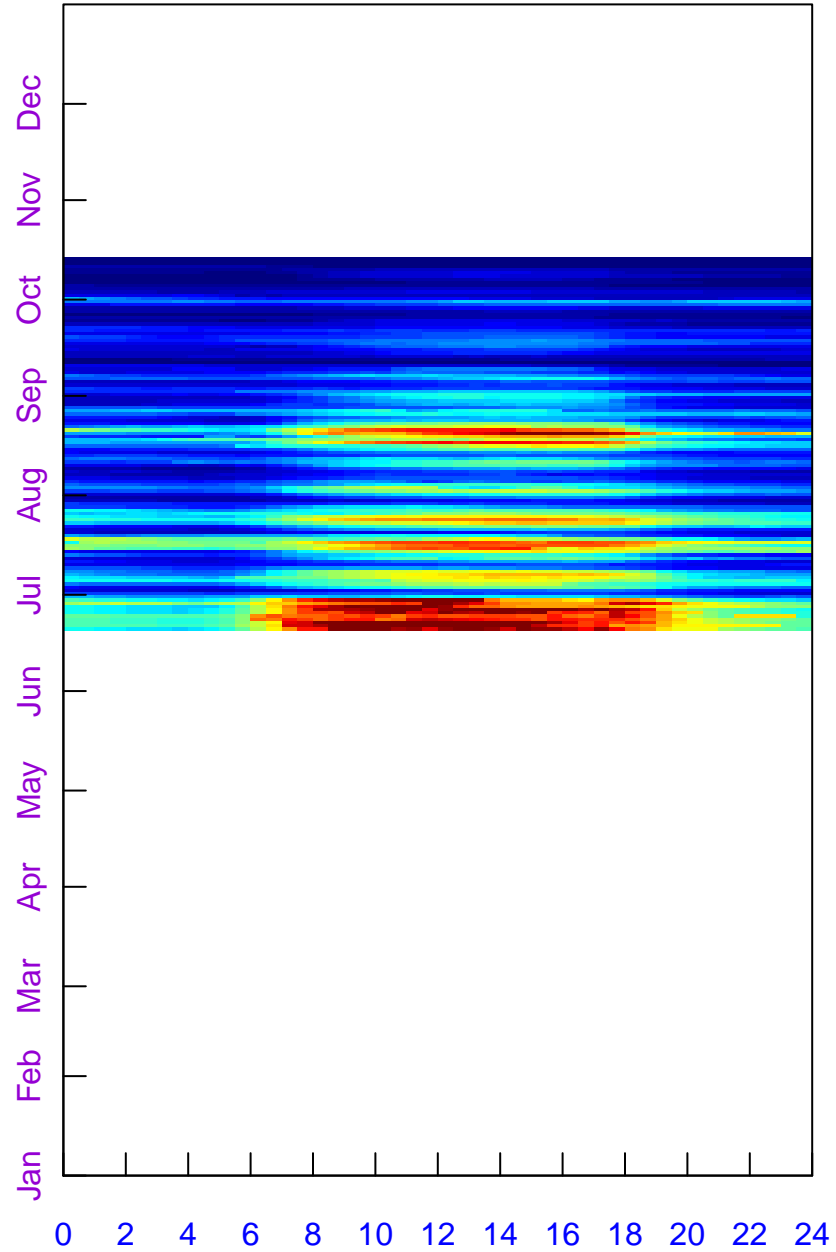